
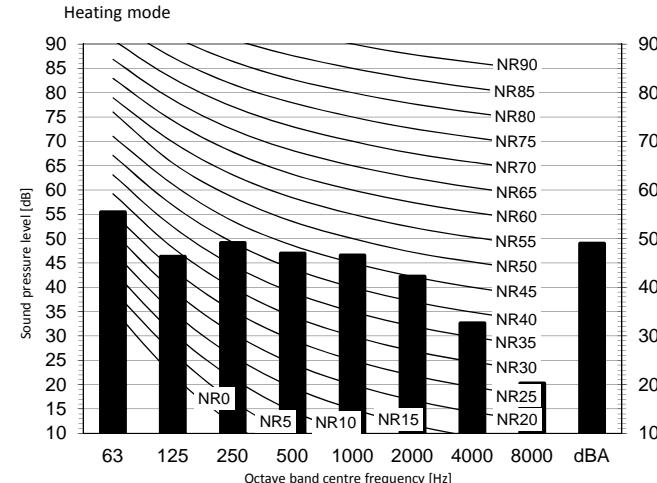


RX60K

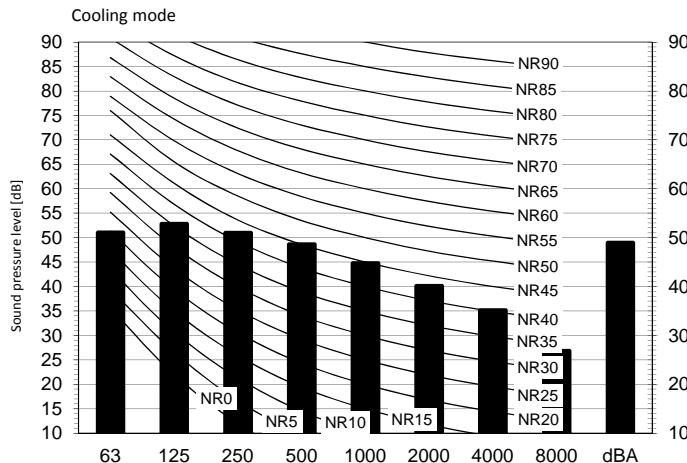

Location of microphone

The operation noise measuring method is in accordance with JISC9612.

Measuring location: anechoic chamber

Cooling		Total dB	
A	B		
dBA	49		
Background noise already taken into account.			

Operating conditions: power source 220-240 V/220 V 50/60 Hz; JIS standard

Notes

Heating		Total dB	
A	B		
dBA	49		
Background noise already taken into account.			

Operating conditions: power source 220-240 V/220 V 50/60 Hz; JIS standard

1 Operating noise varies depending on operation and ambient conditions.