



Cooling

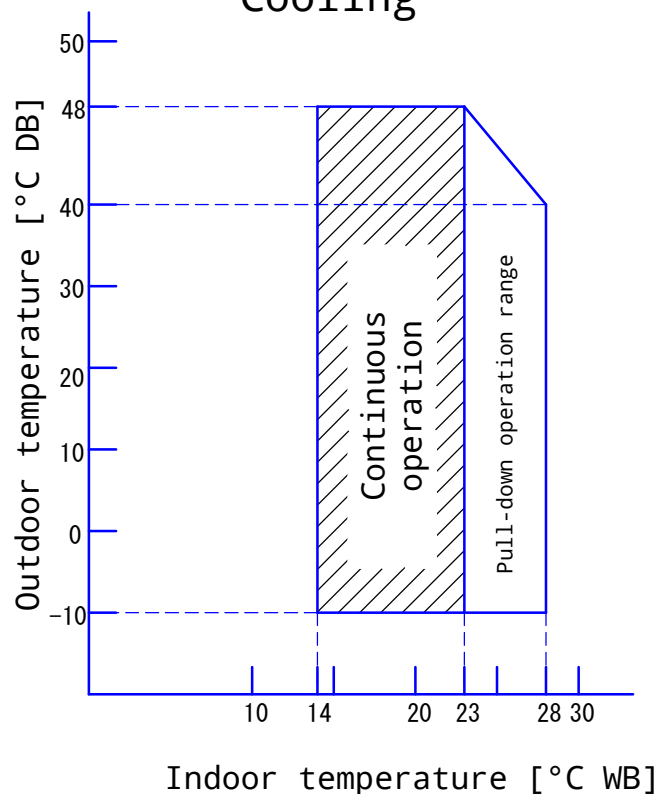

Heating

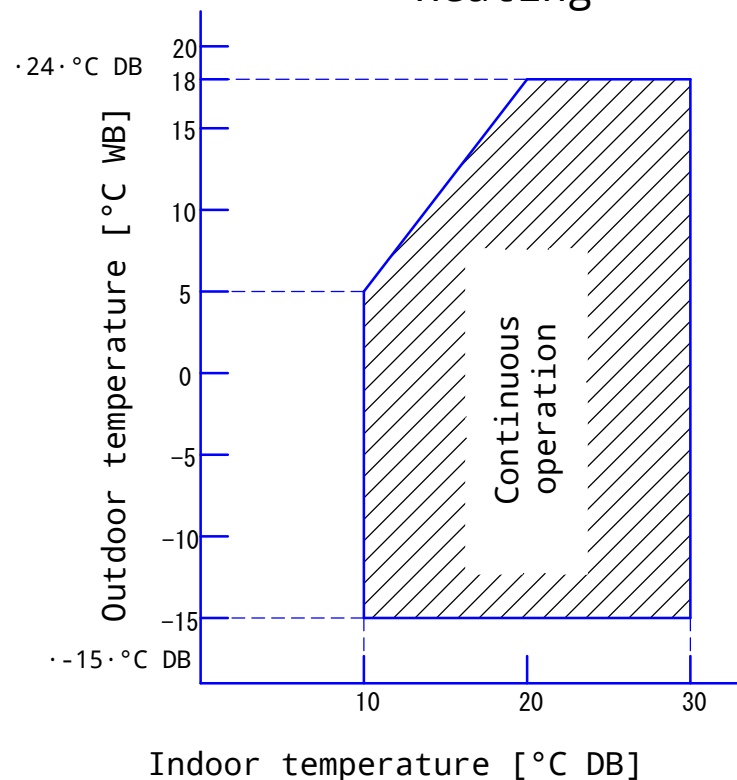

The graphs are based on the following conditions.

Corresponding refrigerant piping length: 5 m

Level difference: 0 m

Air flow rate High