



Cooling

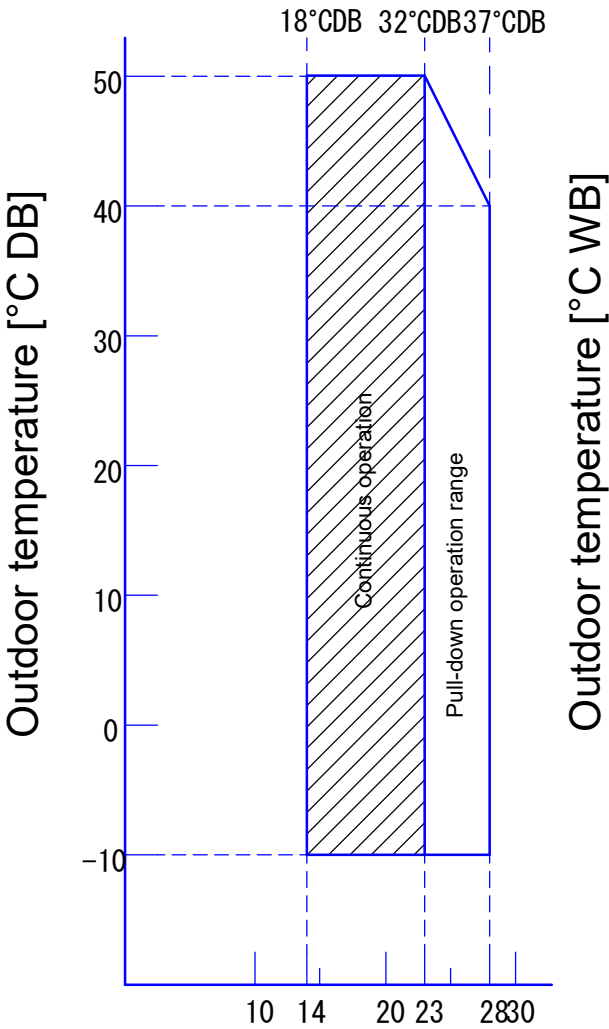

Heating

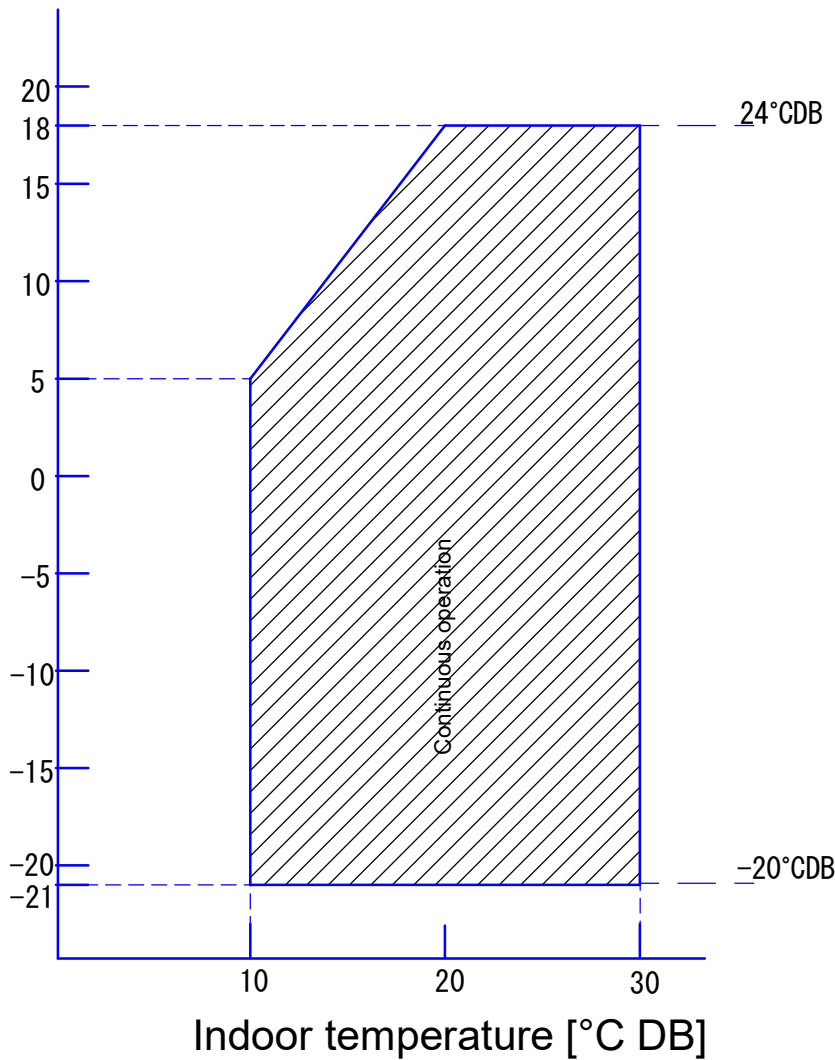

Notes

- 1. The graph is based on the following conditions.
Corresponding refrigerant piping length: 5 m
Level difference: 0 m
Air flow rate High