



Cooling

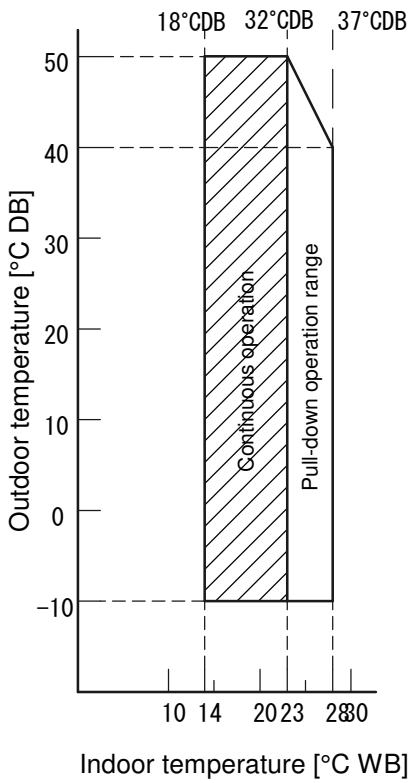


Heating

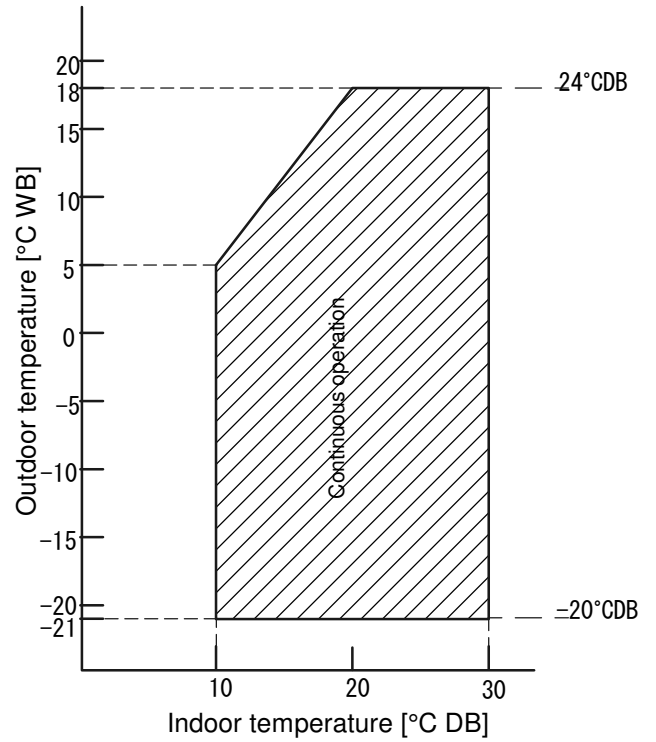


Only possible in combination with ·CTXM\*N2V1B, ATXM\*N2V1B, FTXM\*N2V1B·

Cooling

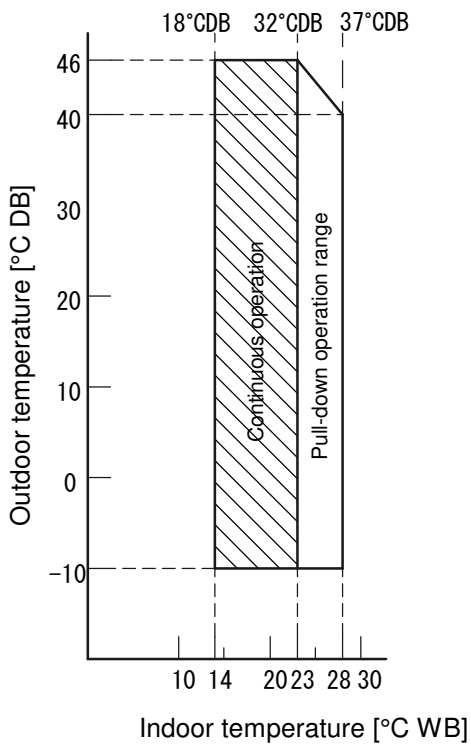

Heating

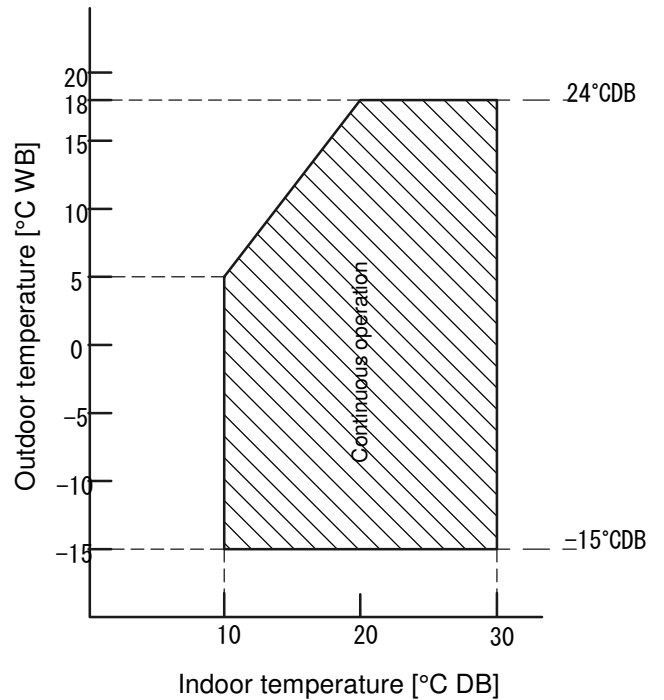

Only possible in combination with ·CTXM\*M2V1B, ATXM\*M2V1B, FTXM\*M2V1B, FVXM\*FV1B, FCAG\*AVEB, FFA\*A2VEB9, FBA\*A2VEB9, FHA\*AVEB9, FDXM\*F3V1B9, FNA\*A2VEB9, ADEA\*A2VEB·

Notes

- The ·graph· is based on the following conditions.  
 Corresponding refrigerant piping length: ·5· m  
 Level difference: ·0·m  
 Air flow rate High