



Cooling

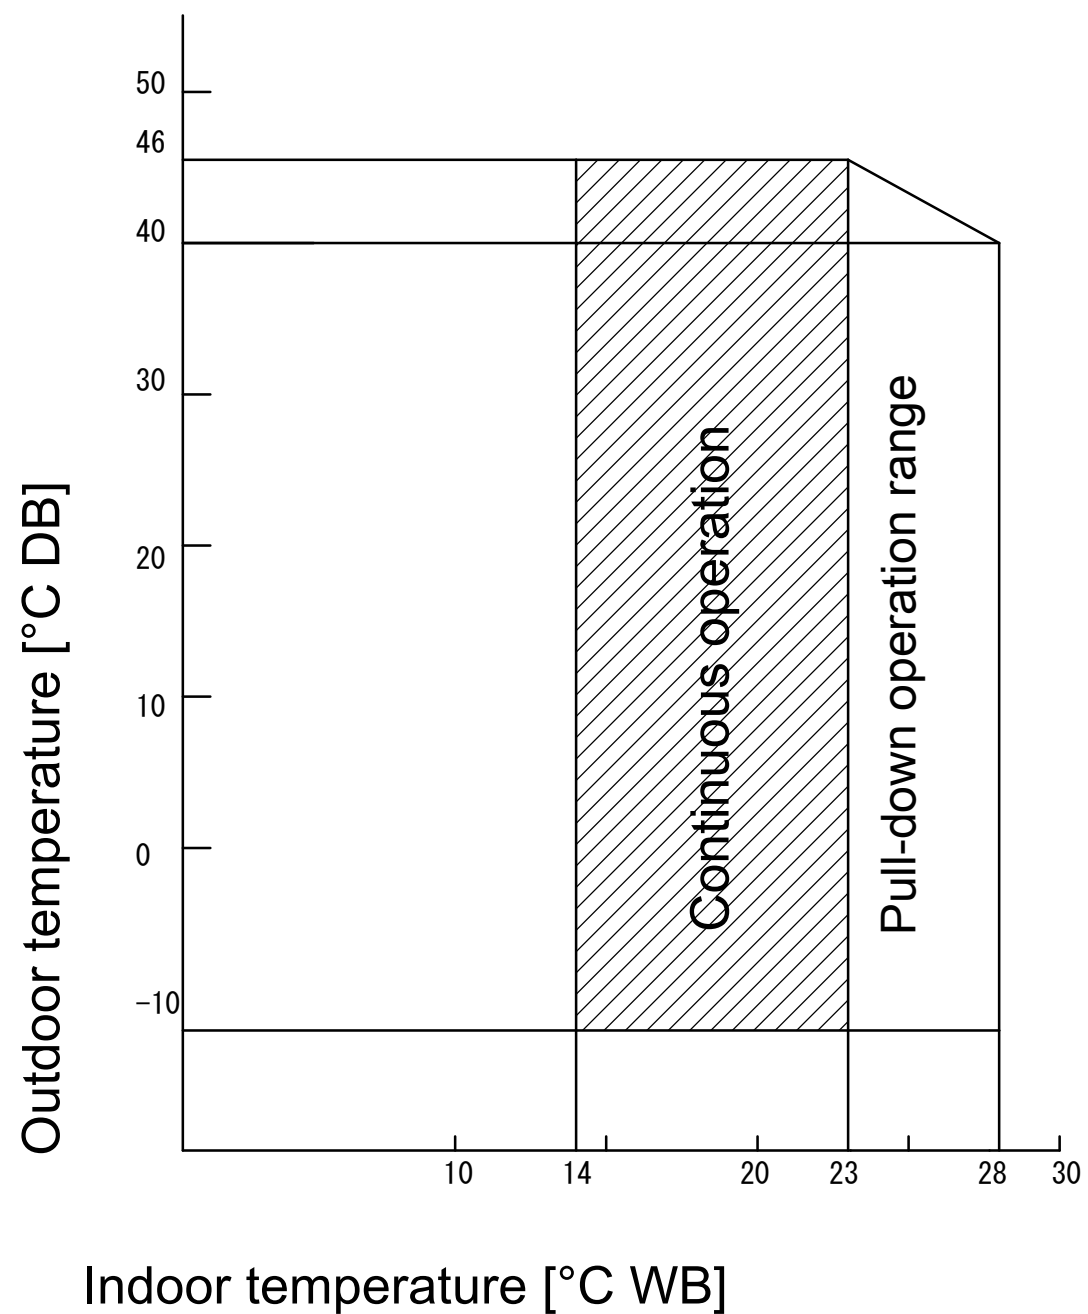

Heating

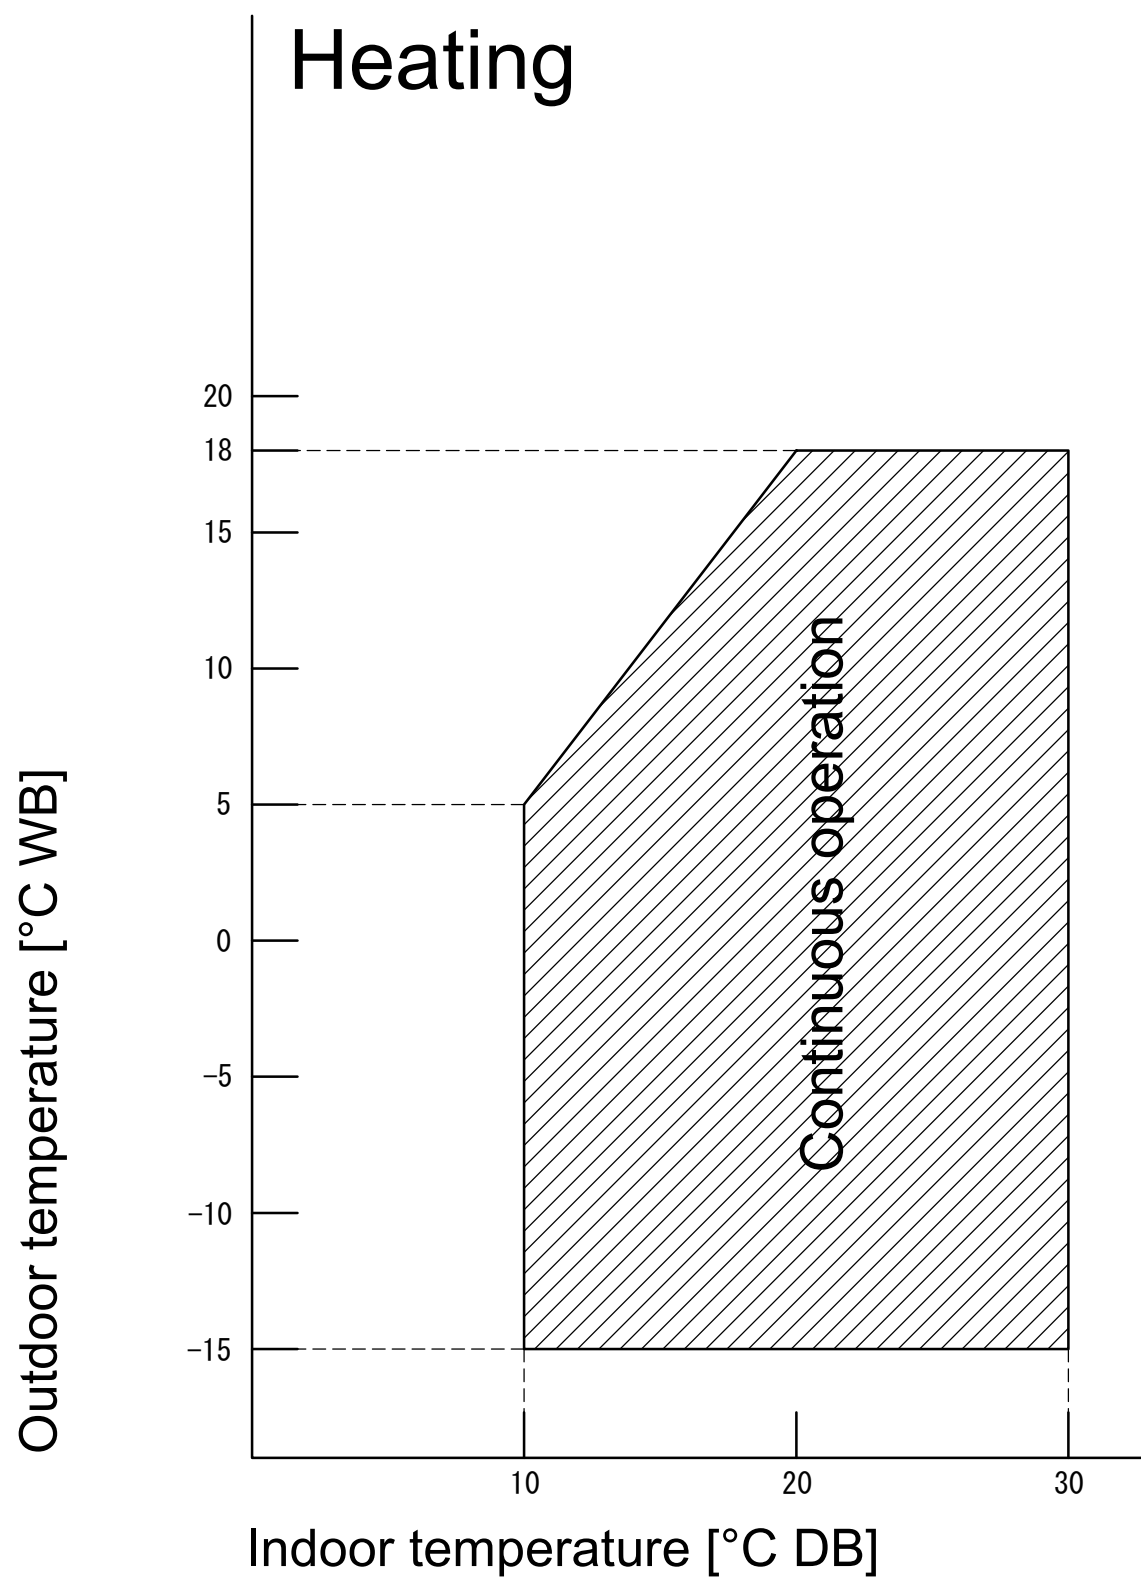

Notes

1. The graphs is based on the following conditions.

Corresponding refrigerant piping length: 5 m

Level difference: 0m

Air flow rate

High