
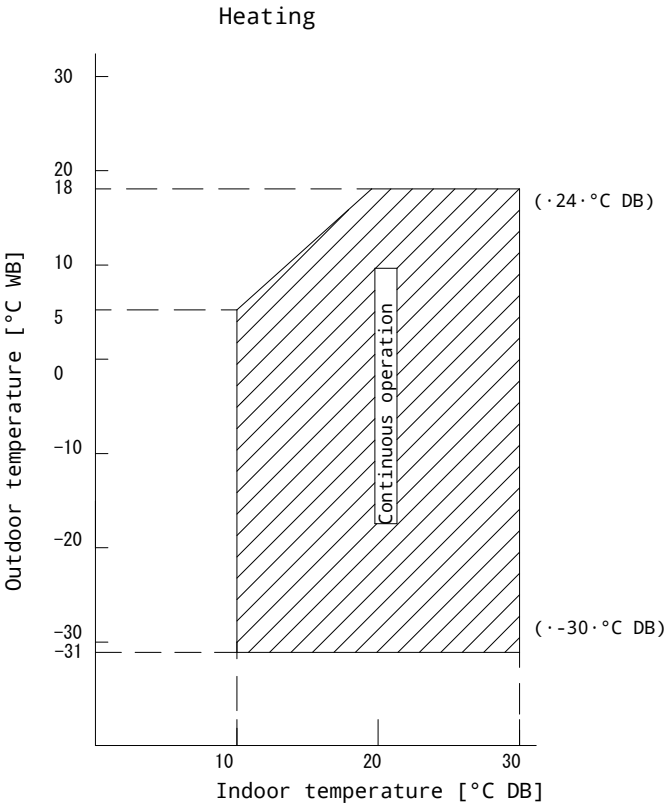


RXTJ-A

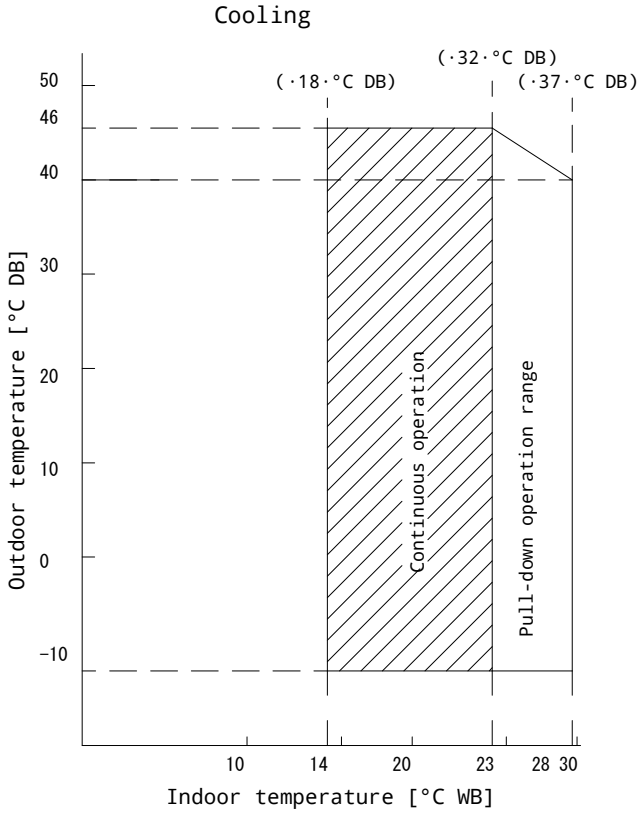

Notes

1)The graph is based on the following conditions.

Corresponding refrigerant piping length: 5 m
Level difference: 0 m
Air flow rate High