


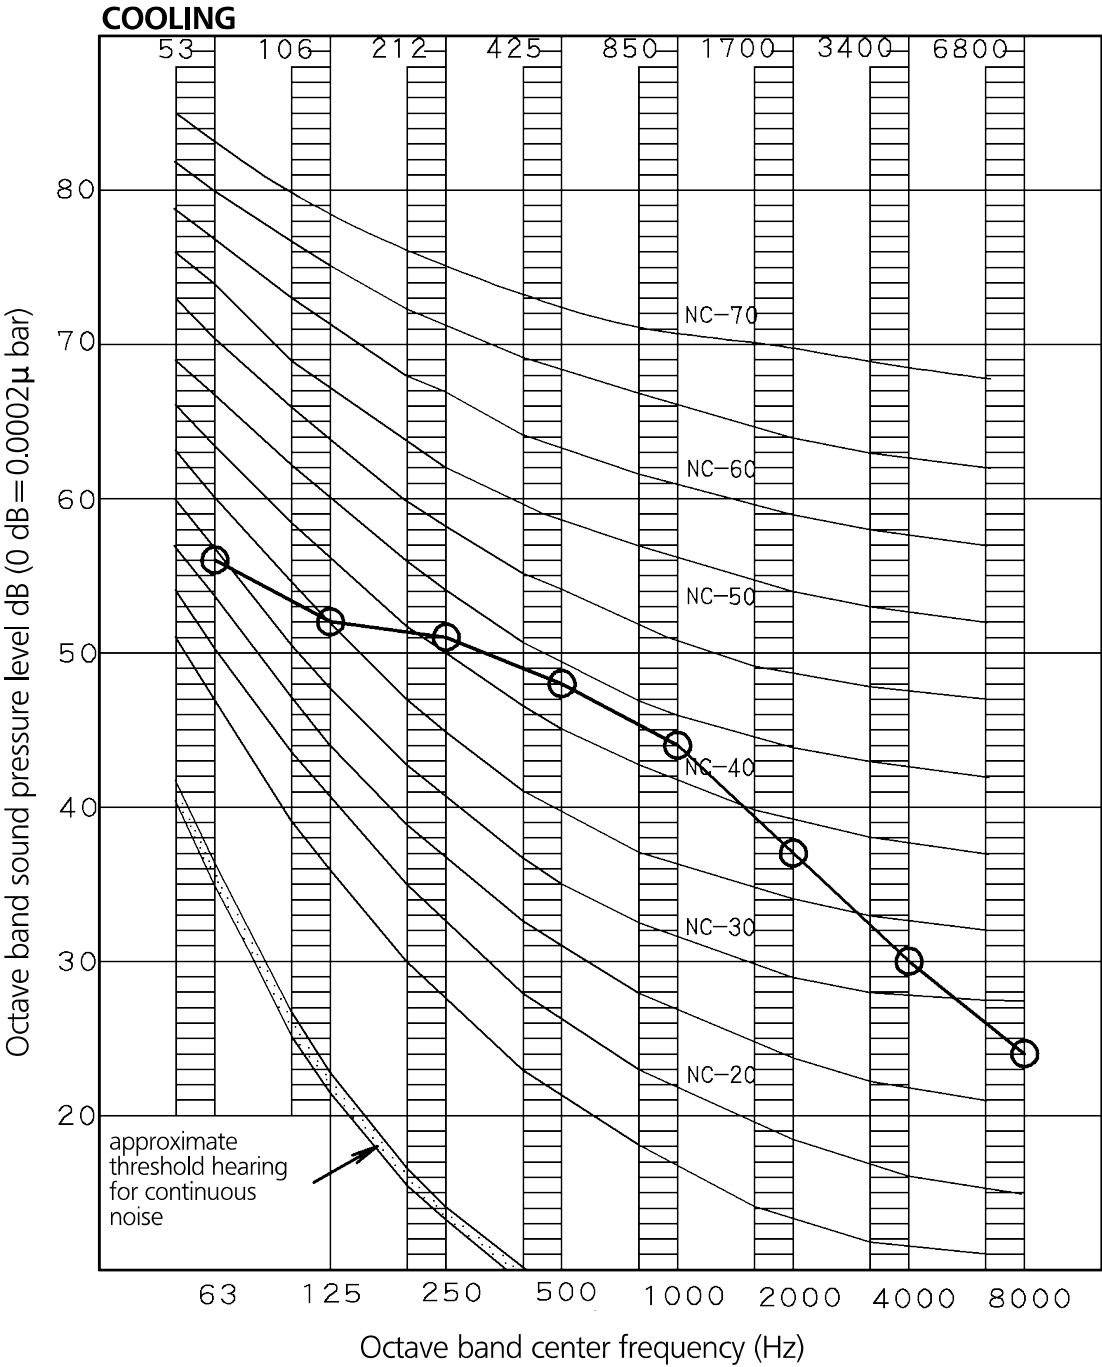

NOTES

1 Overall (dB)

Scale	50Hz 220-240V
A	49

(B,G,N is already rectified)

2 Measuring place: Measured in an echoic room

3 Operation noise differs with operation and ambient conditions.

4 Operating conditions: Power source 220-240V 50Hz

○—○ 50 Hz 220-240V

Cooling

5 Location of microphone

JISC9612

The operation noise measuring method is in accordance with JISC9612