



# Cooling

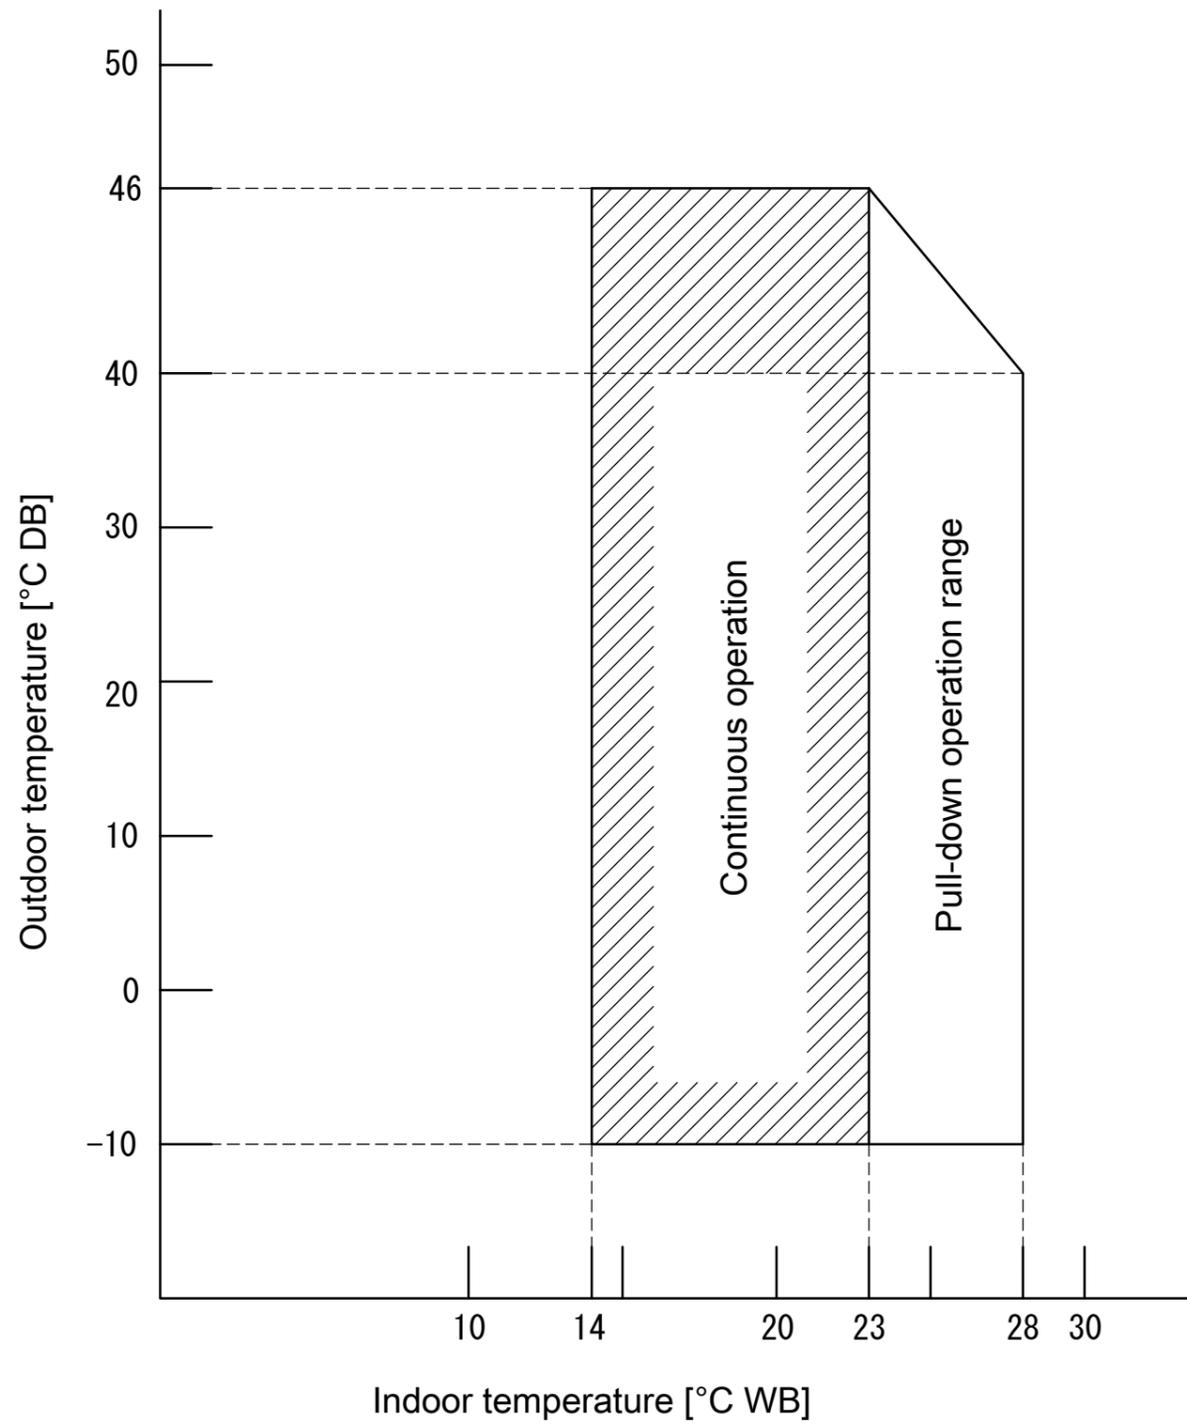

# Heating

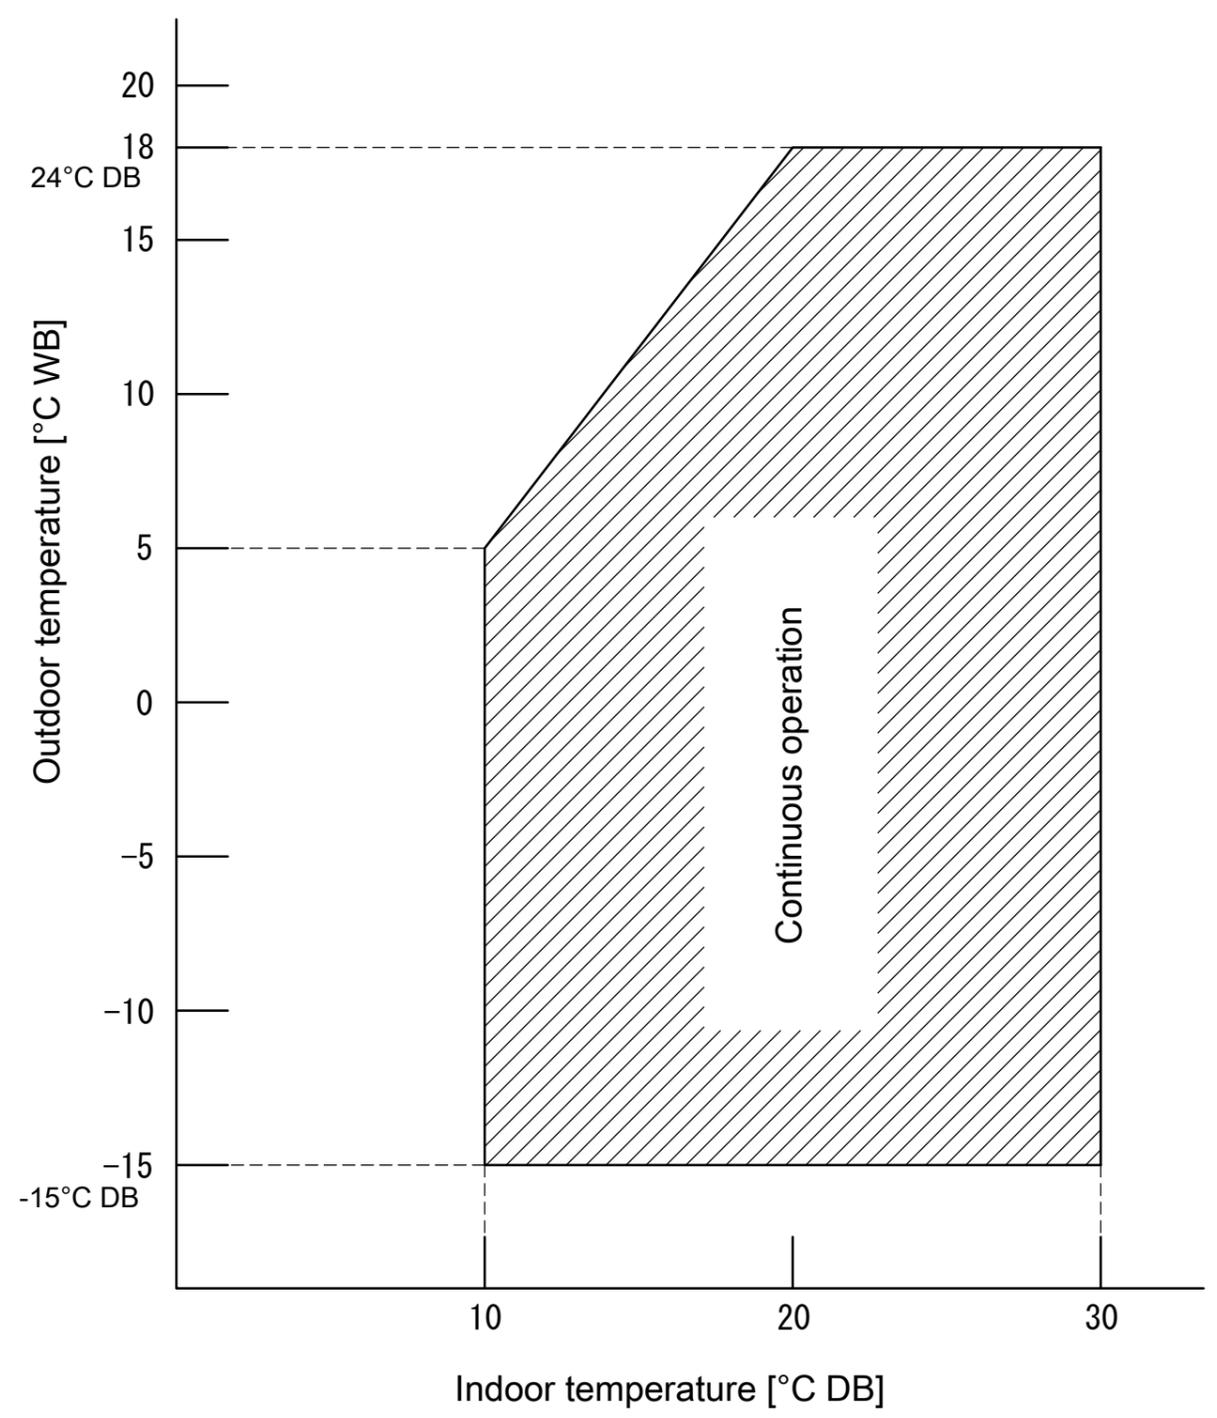

### Notes

- 1. The graphs is based on the following conditions.  
Corresponding refrigerant piping length: 5 m  
Level difference: 0m  
Air flow rate      High