


connect to VRV System

F2 P1

Heating gas pipe  
 Liquid pipe

Biddle Unit External Box Daikin

TG on/off  
 (only for timer)  
 DG speed up  
 PG high speed

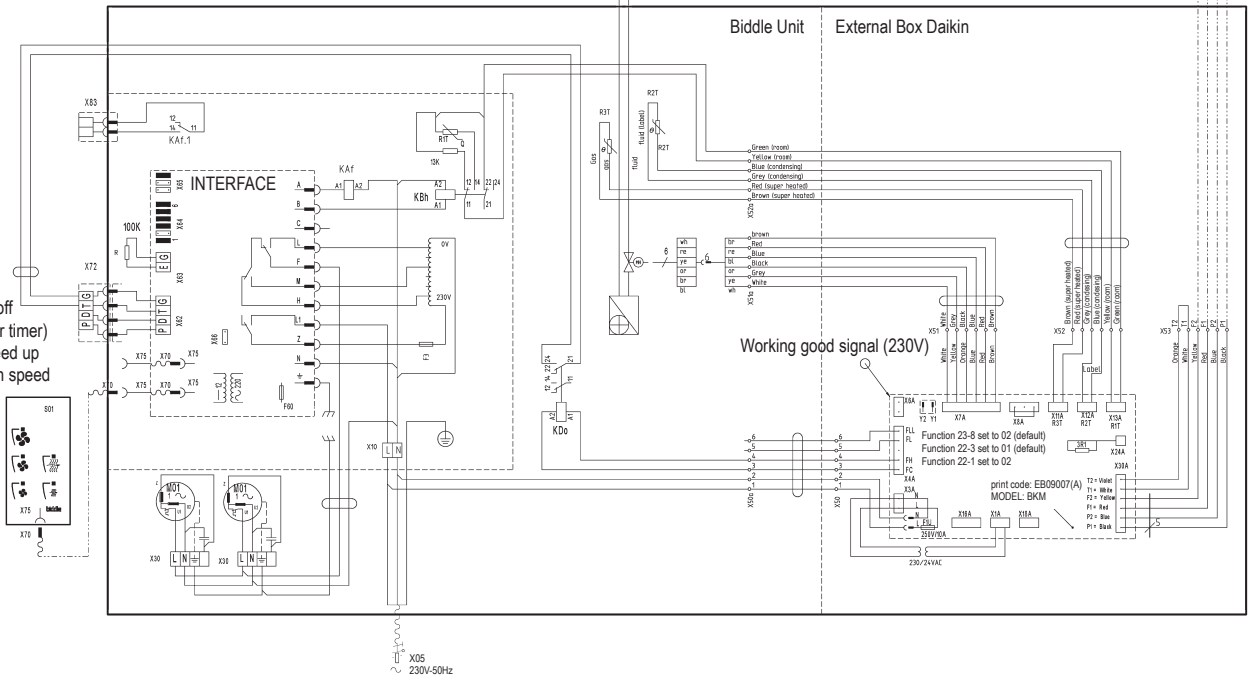

NOTES

KBh, KAf, KDo = Finder relay type 46.52.8.230.0054 (230VAC)