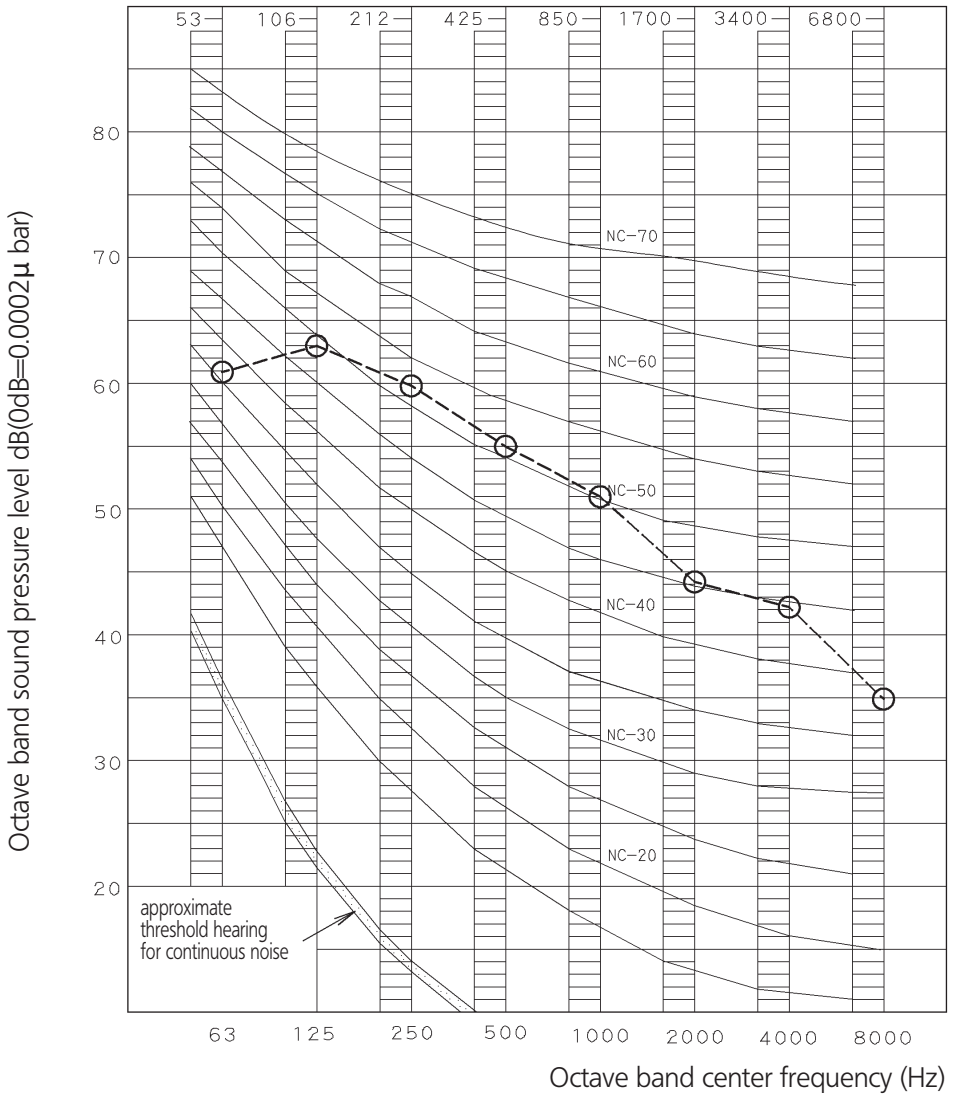


NOTES

1 Over all (dB)
(B,G,N is already rectified)

Scale	50Hz
A	57
C	66

2 Operating conditions:
- Power source: Y1: 380-415V 50Hz
- JIS standard

Measuring place: Anechoic chamber (conversion value)

3 The operating sound is measured in anechoic chamber, if it is measured under the actual installation conditions, it is normally over the set value due to enviromental noise and sound reflection.

4 Location of microphone

