


REYQ-P8/P9
REMQ-P8/P9

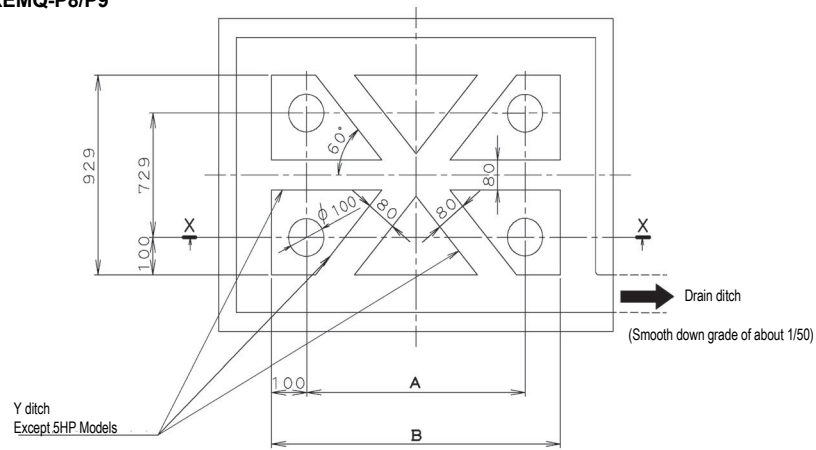

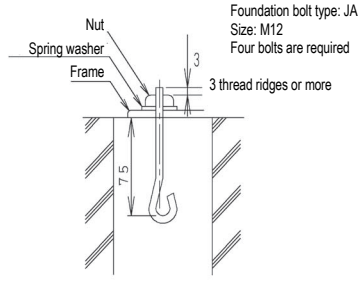

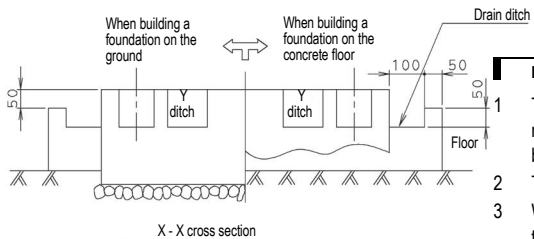

Model	A	B
REMQ10P8 REMQ8,12P9	792	992
REMQ14,16P8	1102	1302
REYQ8,12P9 REYQ10,12,14,16P8	1162	1362

NOTES

1 The proportions of cement:sand:gravel for the concrete shale be 1:2:4, and the reinforcement bars that their diameter are 10mm, (Approx. 300mm intervals) shall be placed.
2 The surface shall be finished with mortar. The corner edges shall be chamfered.
3 When the foundation is build on a concrete floor, rubble is not necessary. However, the surface of the section on which the foundation is built shall have rough finish.
4 A drain ditch shall be made around the foundation to thoroughly drain water from the equipment installation area.
5 When installing the equipment on a roof, the floor strength shall be checked, and water-proofing measures shall be taken.
6 Y ditch is not necessary for 5HP models.