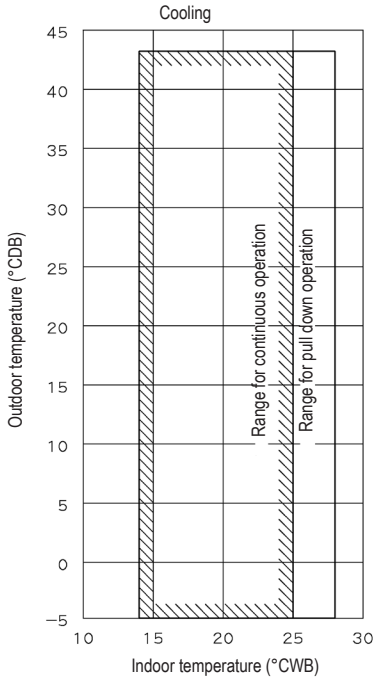
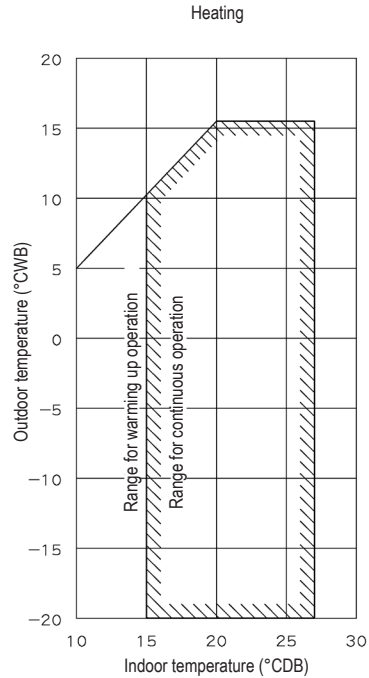

Cooling
45
40
35
30
25
20
15
10
5
0
−5
Outdoor temperature (°CDB)
Range for continuous operation
Range for pull down operation
10
15
20
25
30
Indoor temperature (°CWB)


Heating
20
15
10
5
0
−5
−10
−15
−20
Outdoor temperature (°CWB)
Range for warming up operation
Range for continuous operation
10
15
20
25
30
Indoor temperature (°CDB)