

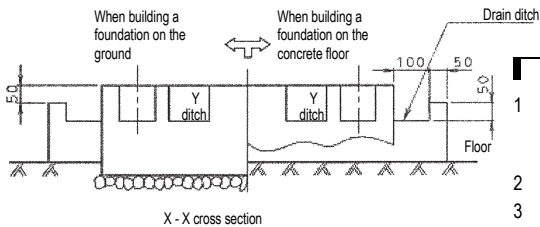


Y ditch  
Except 5HP Models

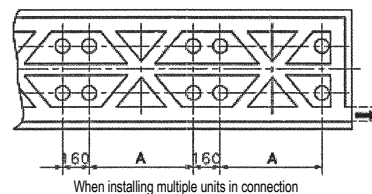

X - X cross section

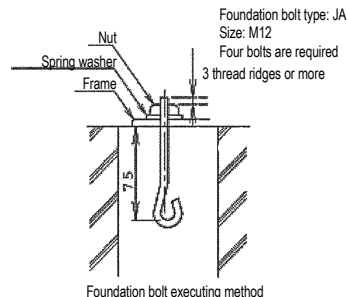

Model	A	B
RXYQ5P	497	697
RXYQ8-10-12P	792	922
RXYQ14-16-18P	1102	1302

## NOTES

- The proportions of cement:sand:gravel for the concrete shall be 1:2:4, and the reinforcement bars that their diameter are 10mm, (Approx. 300mm intervals) shall be placed.
- The surface shall be finished with mortar. The corner edges shall be chamfered.
- When the foundation is built on a concrete floor, rubble is not necessary. However, the surface of the section on which the foundation is built shall have rough finish.
- A drain ditch shall be made around the foundation to thoroughly drain water from the equipment installation area.
- When installing the equipment on a roof, the floor strength shall be checked, and water-proofing measures shall be taken.
- Y ditch is not necessary for 5HP models.