
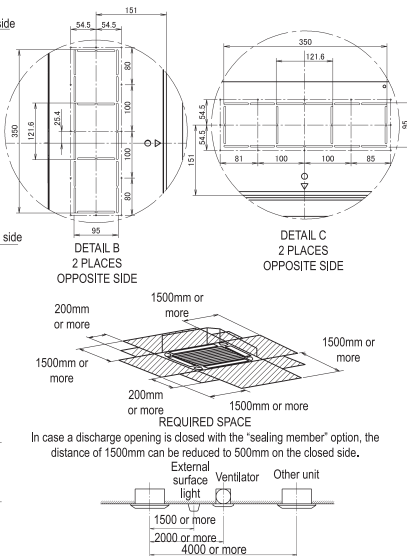


## NOTE

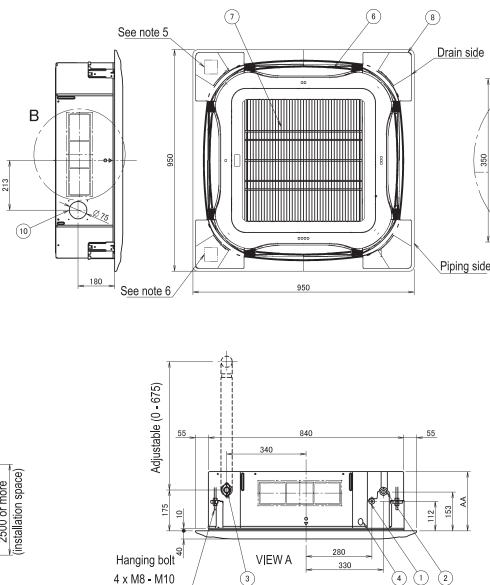

1. Location of the nameplates
  - Unit body: on the control box cover
  - Decoration panel: on the panel frame at the piping side under the corner cover
2. When installing an optional accessory, refer to the installation drawings.
  - For fresh air intake kit an inspection part is necessary
3. Make sure the spacing between the ceiling and the cassette is no more than 35mm. Max ceiling opening: 910mm
4. When the conditions exceed 30°C and RH 80% in the ceiling or fresh air is inducted into the ceiling, an additional insulation is required (polyethylene foam, thickness 10mm or more)
5. In case of using a sensor kit, this position will be a sensor, refer to the drawing of the sensor kit for more detail
6. In case of using a infrared control, this position will be a receiver, refer to the drawing of the infrared control for more detail

| Item | Name                           |
|------|--------------------------------|
| 1    | Liquid pipe connection         |
| 2    | Gas pipe connection            |
| 3    | Drain pipe connection          |
| 4    | Power supply entry hole        |
| 5    | Transmission wiring entry hole |
| 6    | Air discharge opening          |
| 7    | Air suction grille             |
| 8    | Corner decoration cover        |
| 9    | Drain hose                     |
| 10   | Knock out hole                 |

|     | Model                           |
|-----|---------------------------------|
| 256 | FCQG100-140FVEB, FXFQ80-100AVEB |
| 298 | FCQHG71-140FVEB, FXFQ125AVEB    |

3D077130E