




1. : Terminal block
 : Field wiring
 : Connector
 : Short circuit connector
2. X33A, X35A, X38A, X40A, X801A, X15A, X25A are connected when optional accessories are being used, see wiring diagram of this accessory.
3. Can be used for fire alarm input only.
See installation manual for more information.
4. X15A, X25A Are connected when the drain pump kit is being used. Before installing of drain pump kit remove short circuit connector connected to X15A.

BLK : Black
BLU : Blue
YLW : Yellow
BRN : Brown
ORG : Orange
RED : Red
WHT : White
GRN : Green
PNK : Pink
GRY : Grey

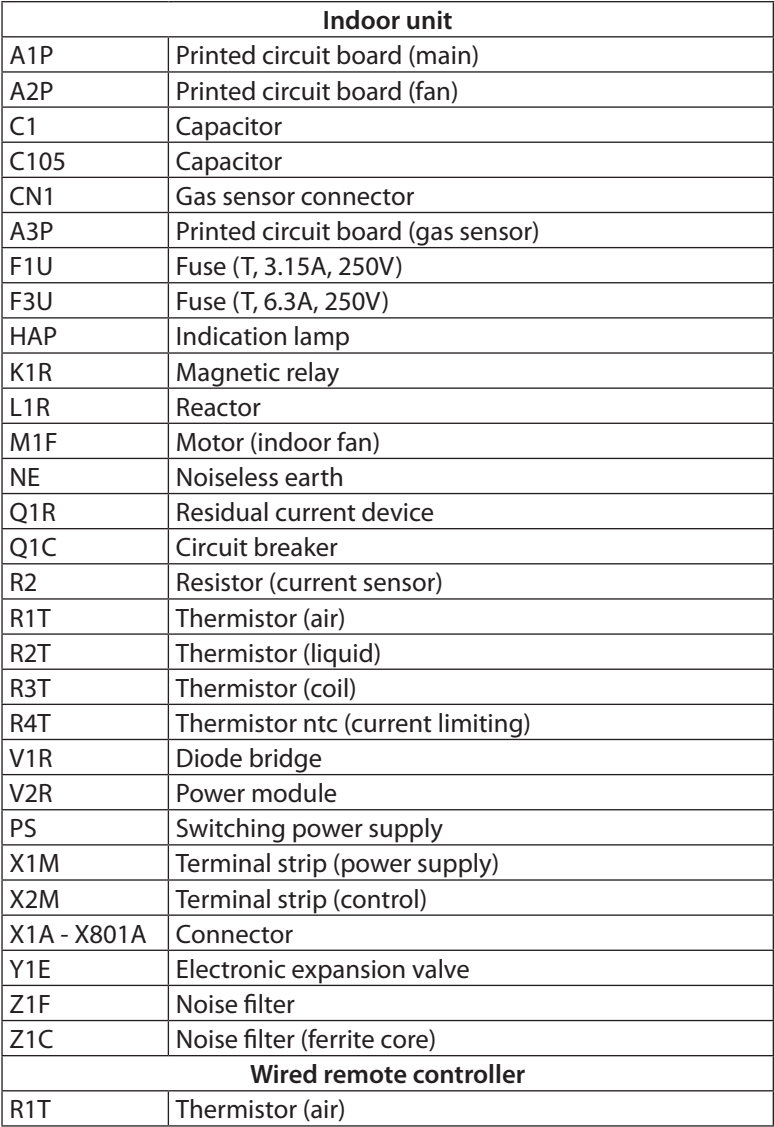