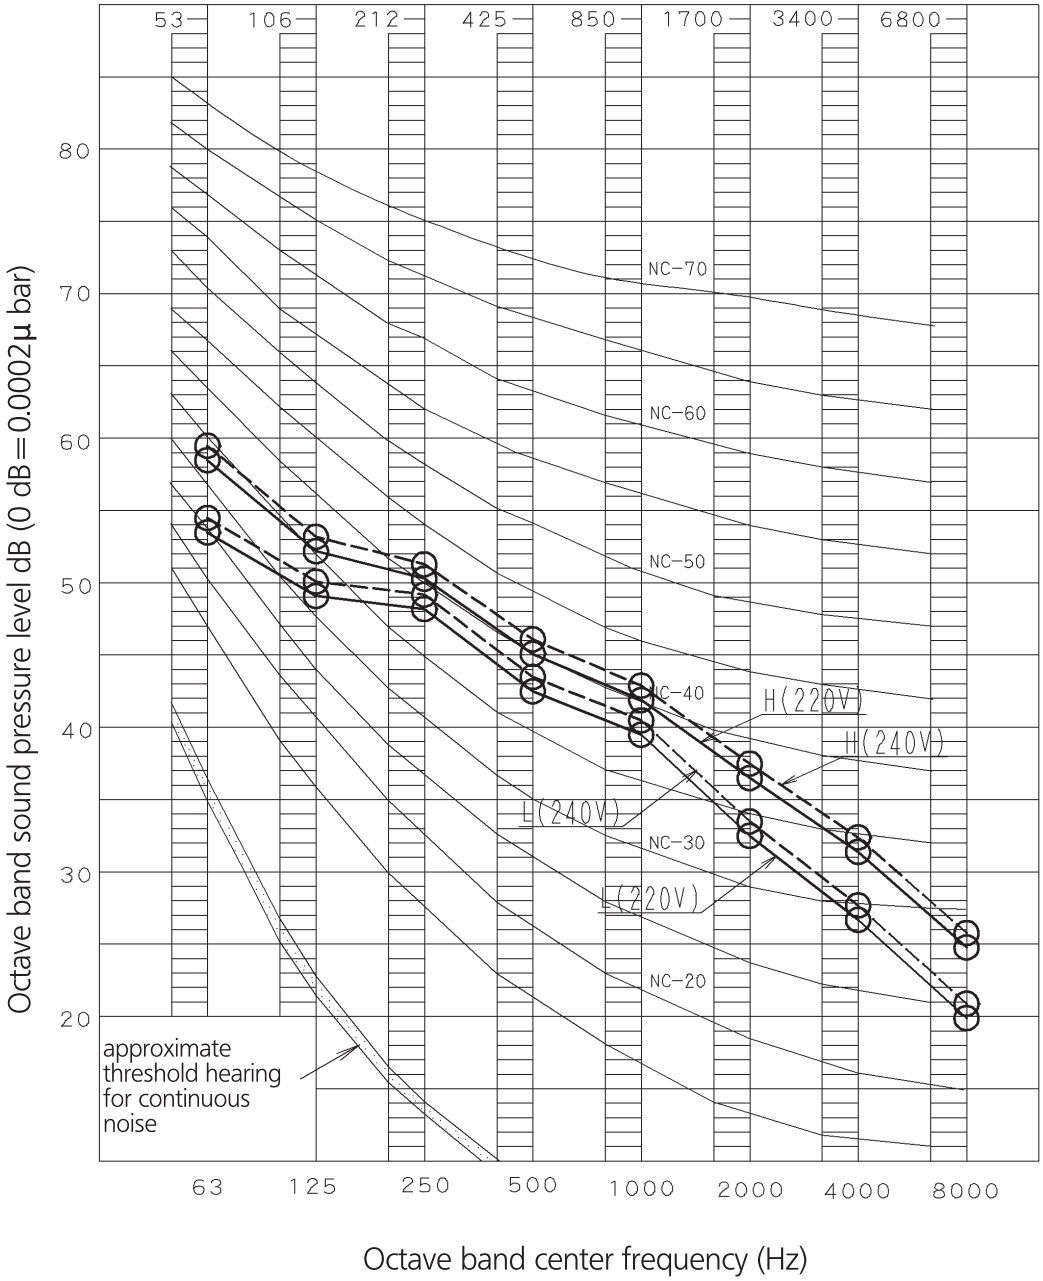


NOTES

1 Overall (dB)

Scale	220V		240V	
	A	L	H	L
A	48	45	49	46
C	60	56	61	57

(B,G,N is already rectified)

2 Measuring place: Measure in anechoic room

3 Operation noise differs with operation and ambient conditions.

4 Operating conditions:
Power source 220-240V/220V 50/60Hz

5 standard condition (JIS)
○——○ 220V
○---○ 240V
ESP: 132/132Pa (220V 50/60Hz)

6 Location of microphone: JIS B8616