



## Cooling

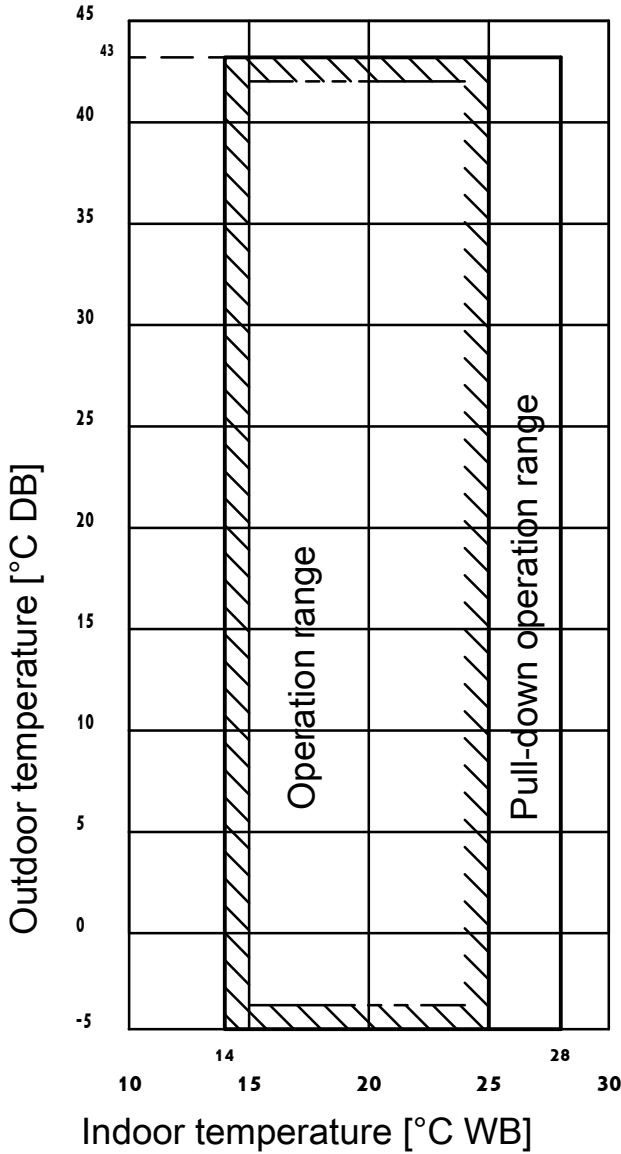

## Heating

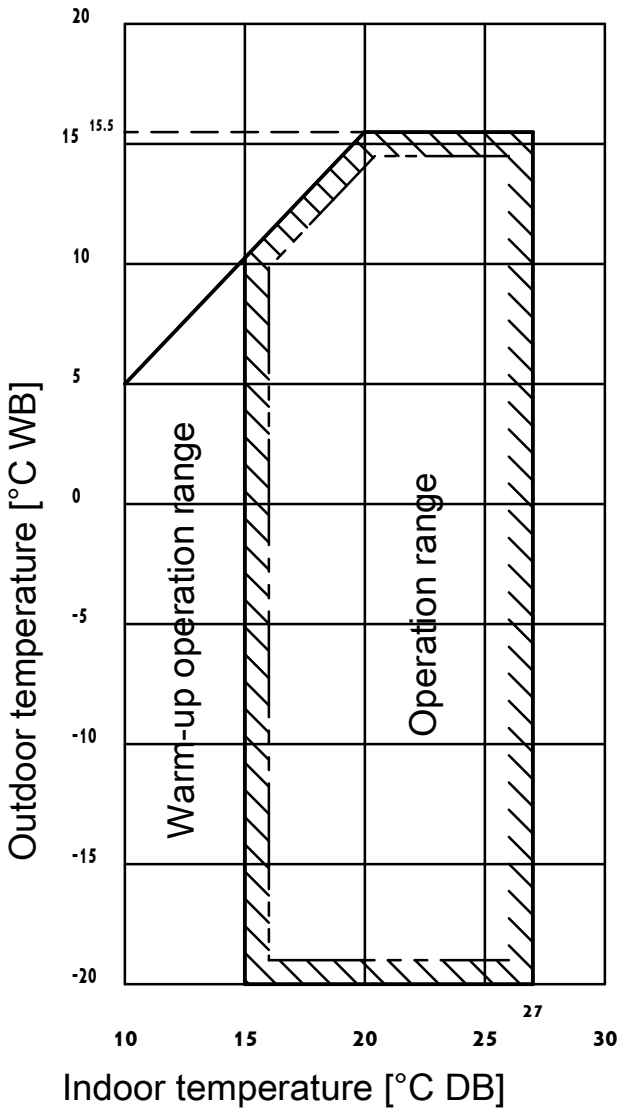

### Notes

- These figures assume the following operation conditions  
Indoor and outdoor units  
Equivalent piping length: 5m  
Level difference: 0m
- Depending on operation and installation conditions, the indoor unit can change over to freeze-up operation (indoor de-icing).
- To reduce the freeze-up operation (indoor de-icing) frequency, it is recommended to install the outdoor unit in a location not exposed to wind.
- Operation range is valid in case direct expansion indoor units are used.