

# RXYSQ-TY9

# RXYSQ-TV9

## ● Obstacle above, too

### ① Stand-alone installation

The relations between H, A and L are as follows.

	L	A
$L \leq H$	$0 < L \leq 1/2 H$	750
	$1/2 H < L \leq H$	1000
$H < L$	Set the stand as: $L \leq H$	



Close the bottom of the installation frame to prevent the discharged air from being bypassed.

### ② Series installation (2 or more)

The relations between H, A and L are as follows.


	L	A
$L \leq H$	$0 < L \leq 1/2 H$	1000
	$1/2 H < L \leq H$	1250
$H < L$	Set the stand as: $L \leq H$	

Close the bottom of the installation frame to prevent the discharged air from being bypassed.  
Only two units can be installed for this series.

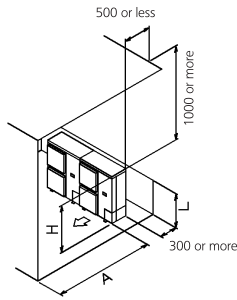

### Pattern 2

When the obstacle on the discharge side is lower than the unit:  
(There is no height limit for obstructions on the intake side.)

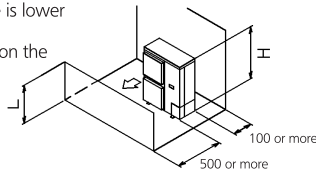

## ● No obstacle above


### ① Stand-alone installation

$L \leq H$

### ② Series installation (2 or more)

The relations between H, A and L are as follows.

	L	A
$L \leq H$	$0 < L \leq 1/2 H$	250
	$1/2 H < L \leq H$	300

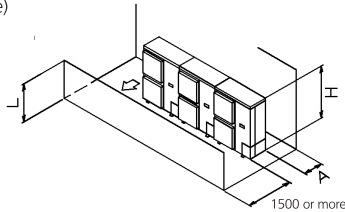


## ● Obstacle above, too

### ① Stand-alone installation

The relations between H, A and L are as follows.

	L	A
$L \leq H$	$0 < L \leq 1/2 H$	100
	$1/2 H < L \leq H$	200
$H < L$	Set the stand as: $L \leq H$	

Close the bottom of the installation frame to prevent the discharged air from being bypassed.



## ② Series installation

The relations between H, A and L are as follows.

	L	A
$L \leq H$	$0 < L \leq 1/2 H$	250
	$1/2 H < L \leq H$	300
$H < L$	Set the stand as: $L \leq H$	

Close the bottom of the installation frame to prevent the discharged air from being bypassed.

Only two units can be installed for this series.

## (D) Double-decker installation

### ① Obstacle on the discharge side.




Close the gap A (the gap between the upper and lower outdoor units) to prevent the discharged air from being bypassed.

Do not stack more than two unit.

### ② Obstacle on the suction side.


Close the gap A (the gap between the upper and lower outdoor units) to prevent the discharged air from being bypassed.

Do not stack more than two unit.



## (E) Multiple rows of series installation (on the rooftop, etc.)

### ① One row of stand-alone installation

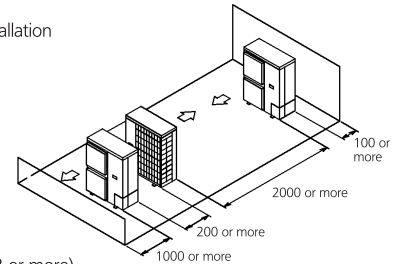

### ② Rows of series installation (2 or more)

The relations between H, A and L are as follows.

	L	A
$L \leq H$	$0 < L \leq 1/2 H$	250
	$1/2 H < L \leq H$	300
$H < L$	Can not be installed	

