


VRV4
Heat pump
Piping restrictions ·2/3·

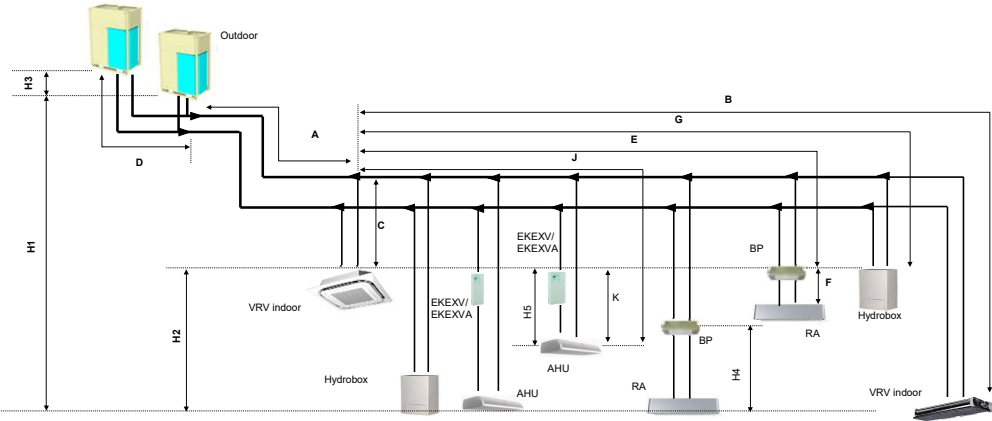

Remark
(1) Schematic indication
Illustrations may differ from the actual appearance of the unit.
(2) This is only to illustrate piping length limitations.
Combination of indoor unit types is not allowed.
Refer to combination table ·3D079543· for details about the allowed combinations.

		Allowed piping length		Maximum height difference	
		·BP· to ·RA·	·EKEXV/EKEXVA· to ·AHU·	·BP· to ·RA·	·EKEXV/EKEXVA· to ·AHU·
		(F)	(K)	(H4)	(H5)
·RA· connection		2~15m	-	5m	-
·AHU· connection	Pair	-	≤5m	-	5m
	Multi ⁽¹⁾	-	≤5m	-	5m
	Mix ⁽²⁾	-	≤5m	-	5m

Remark
(1) Multiple air handling units (AHU)(·EKEXV· + ·EKEXV· kits) or (AHU)(·EKEXVA· + ·EKEXVBE· kits).
(2) Mix of ·AHU· units and ·VRV DX indoor·.