


Outlet pressure (P_{OUT}) in function of the air flow rate exiting the $\cdot SV \cdot$ unit (AFR_{OUT})

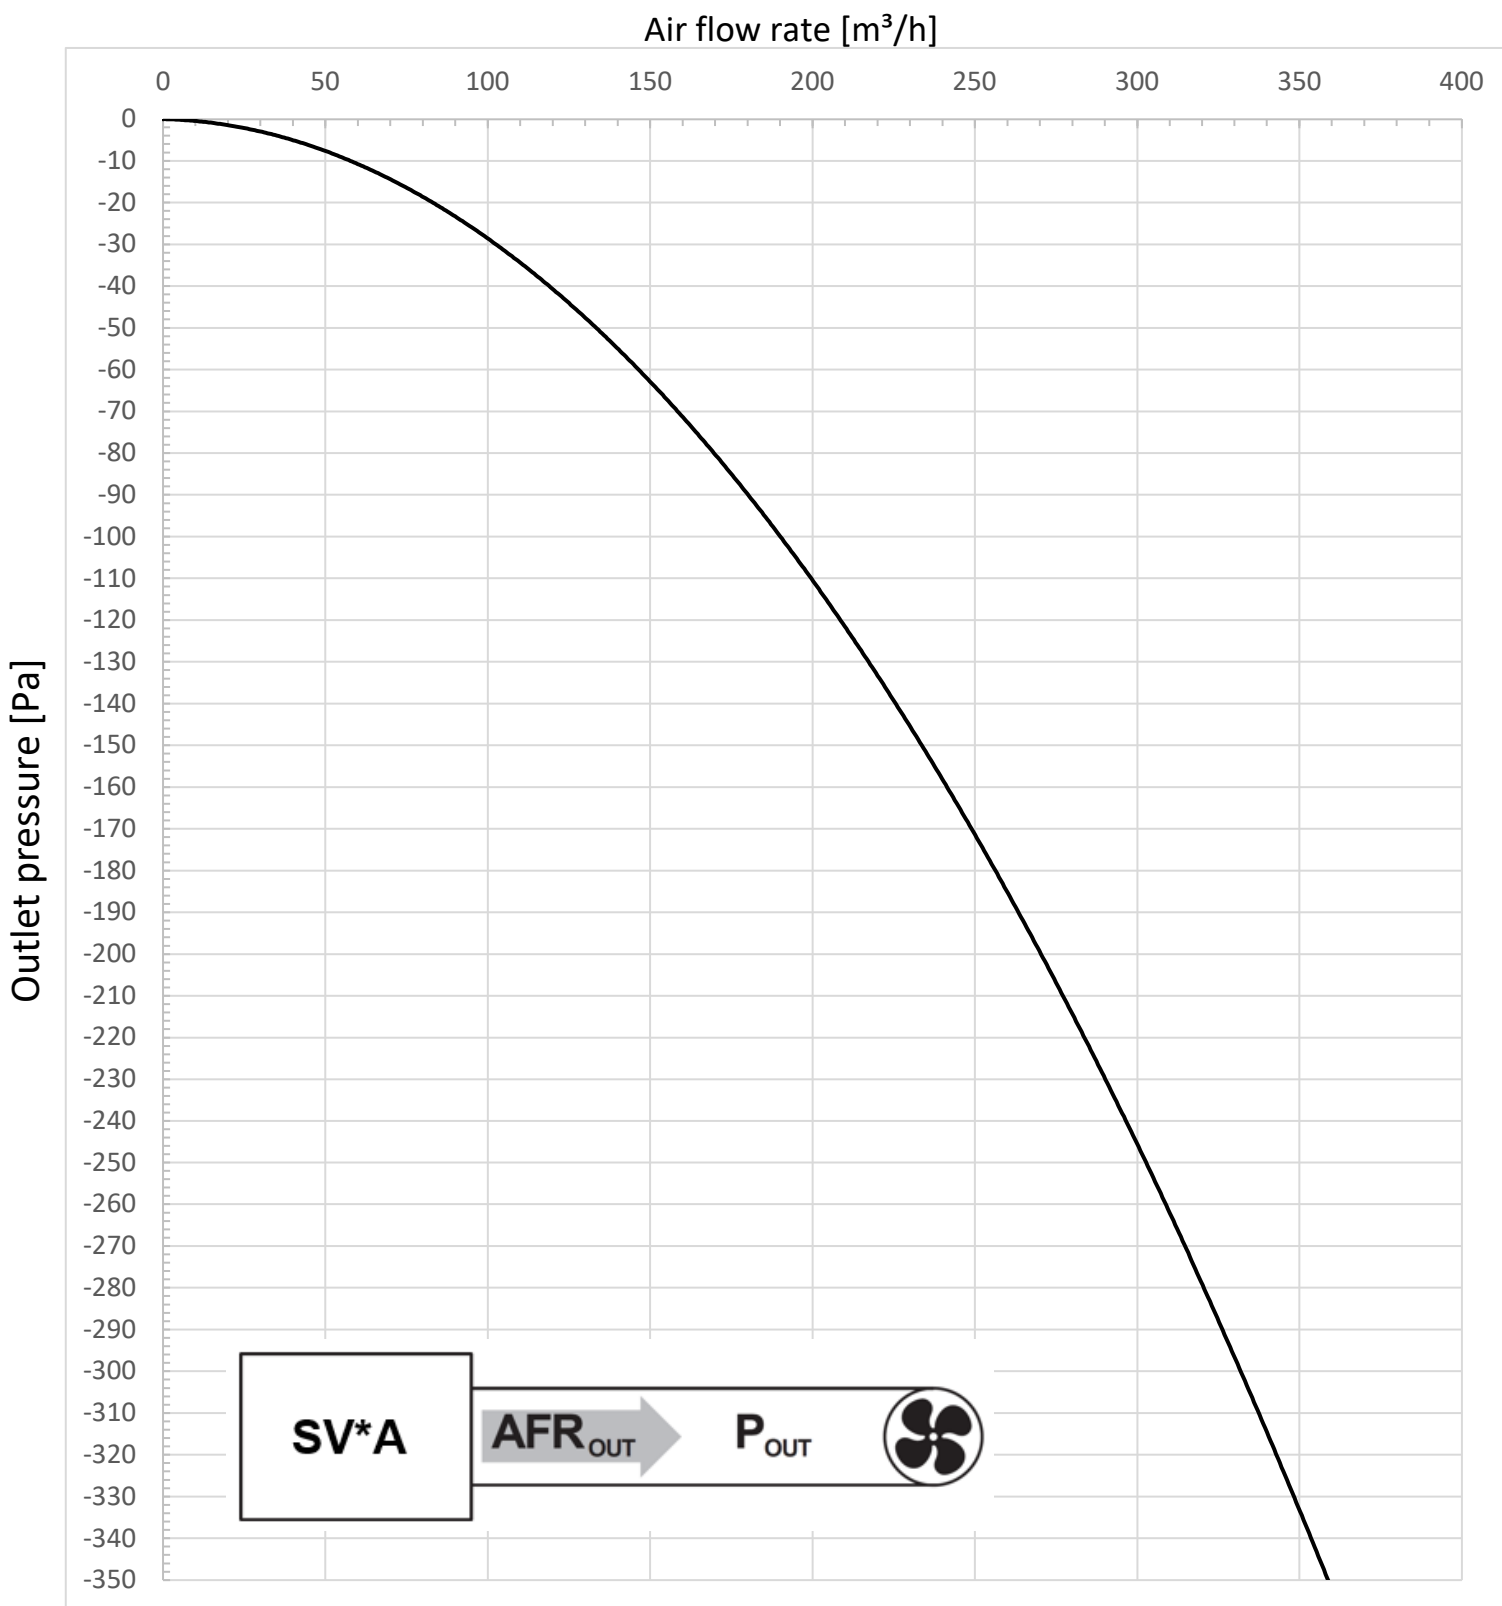

AFR_{OUT} Air flow rate [m^3/h]

P_{OUT} Outlet pressure [Pa]

Notes

1. Pressure curves are only valid for one $\cdot SV \cdot$ unit to one extraction fan configurations.
2. In case multiple $\cdot SV \cdot$ units are combined in one duct network, refer to $\cdot VRV \cdot$ Xpress Selection Software (<https://vrvxpress.daikin.eu>) to calculate the necessary static pressure of the fan.