FXKA20-32A
FXKQ20-32A

Notes

1. Location of nameplate
   The unit nameplate is located on the control box cover.
   The decoration panel nameplate is located on the inner frame inside the suction grille.
2. Though the installation is acceptable up to maximum ·910×510·mm square ceiling opening, keep the clearance of ·35·mm or less between the indoor unit and the ceiling opening, so that the panel overlap allowance can be ensured.
3. When installing optional accessories, refer to their respective documentation.
4. If any of the following conditions are met, additional insulation (glass wool or polyethylene foam, thickness ≥ 10·mm) is required:
   Ambient conditions in the ceiling ≥ ·30·°C and ·80·% relative humidity.

Fresh air is inducted into the ceiling.
The unit operates continuously.

Model	øA	øB
FXKQ20AMVEB	6.4	12.7
FXKQ25AMVEB	6.4	12.7
FXKQ32AMVEB	6.4	12.7
FXKA20AMVEB	6.4	9.5
FXKA25AMVEB	6.4	9.5
FXKA32AMVEB	6.4	9.5

Item	Part name
1	Liquid pipe connection ·øA·
2	Gas pipe connection ·øB·
3	Drain outlet Inside diameter: ·20·mm Outside diameter: ·26·mm
4	Power supply wiring intake
5	Wiring connection Remote control wiring intake

Item	Part name
6	Air discharge side
7	Air suction side
8	Drain hose (accessory) Inside diameter: ·25·mm
9	Metal hanger

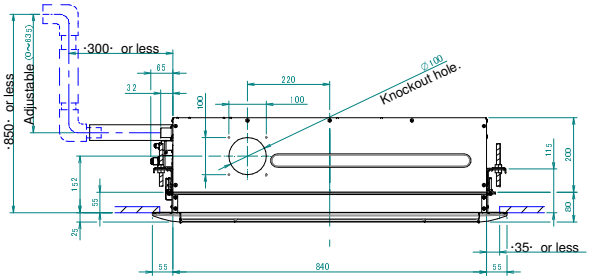

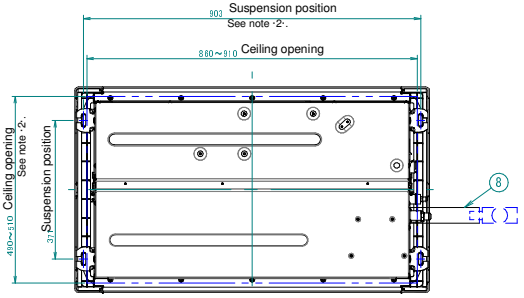

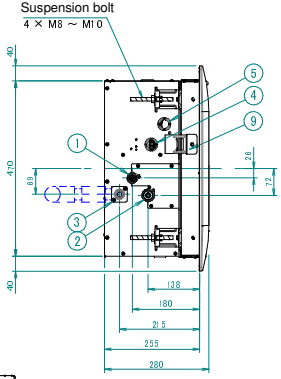

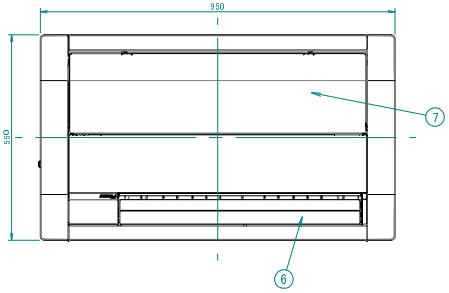

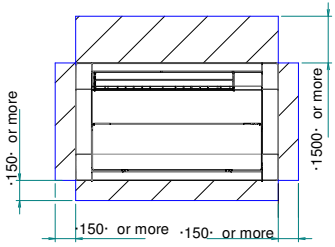



Required space

Adjusting the air flow direction