

FXKA40-63A

Notes

1. Location of nameplate

The unit nameplate is located on the control box cover.

The decoration panel nameplate is located on the inner frame inside the suction grille.

2. Though the installation is acceptable up to maximum 1310x510-mm square ceiling opening, keep the clearance of 35-mm or less between the indoor unit and the ceiling opening, so that the panel overlap allowance can be ensured.

3. When installing optional accessories, refer to their respective documentation.


4. If any of the following conditions are met, additional insulation (glass wool or polyethylene foam, thickness ≥ 10-mm) is required:

Ambient conditions in the ceiling ≥ 30°C and 80% relative humidity.

Fresh air is inducted into the ceiling.
The unit operates continuously.


Model	øA	øB
FXKQ40AMVEB	6.4	12.7
FXKQ50AMVEB	6.4	12.7
FXKQ63AMVEB	9.5	15.9
FXKA40AMVEB	6.4	12.7
FXKA50AMVEB	6.4	12.7
FXKA63AMVEB	6.4	12.7

Item	Part name	Item	Part name
①	Liquid pipe connection -øA-	④	Air discharge side
②	Gas pipe connection -øB-	⑤	Air suction side
③	Drain outlet Inside diameter: 20-mm Outside diameter: 26-mm	⑥	Drain hose (accessory) Inside diameter: 25-mm
④	Power supply wiring intake	⑦	Metal hanger
⑤	Wiring connection Remote control wiring intake		

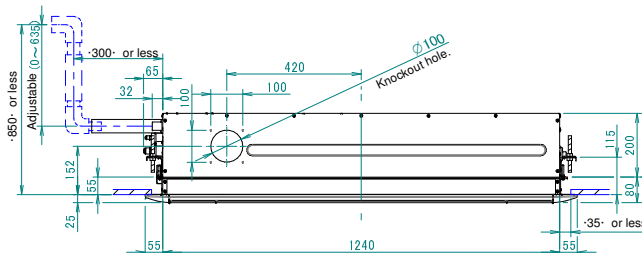





Suspension position

See note 2.

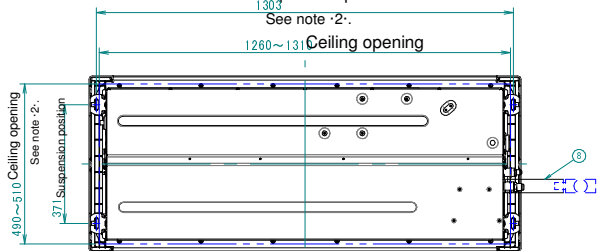

Suspension bolt

4 × M8 ~ M10

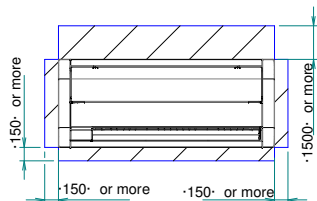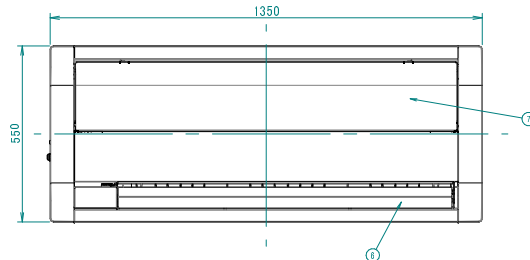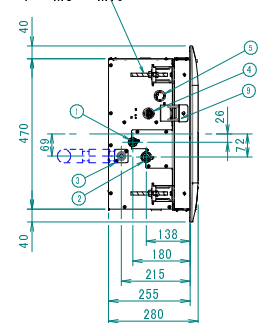

Required space

Adjusting the air flow direction

Up/down (automatic)

Left/right (automatic)

