
Notes

1. In case the unit is selected to operate at ambient temperatures lower than ·-5°C· for ·3· consecutive days or longer, with a relative humidity exceeding ·>95·%:
   It is recommended to install the optional bottom plate heater (·EKBPH010N·) to keep drain holes open.

Heating



Cooling

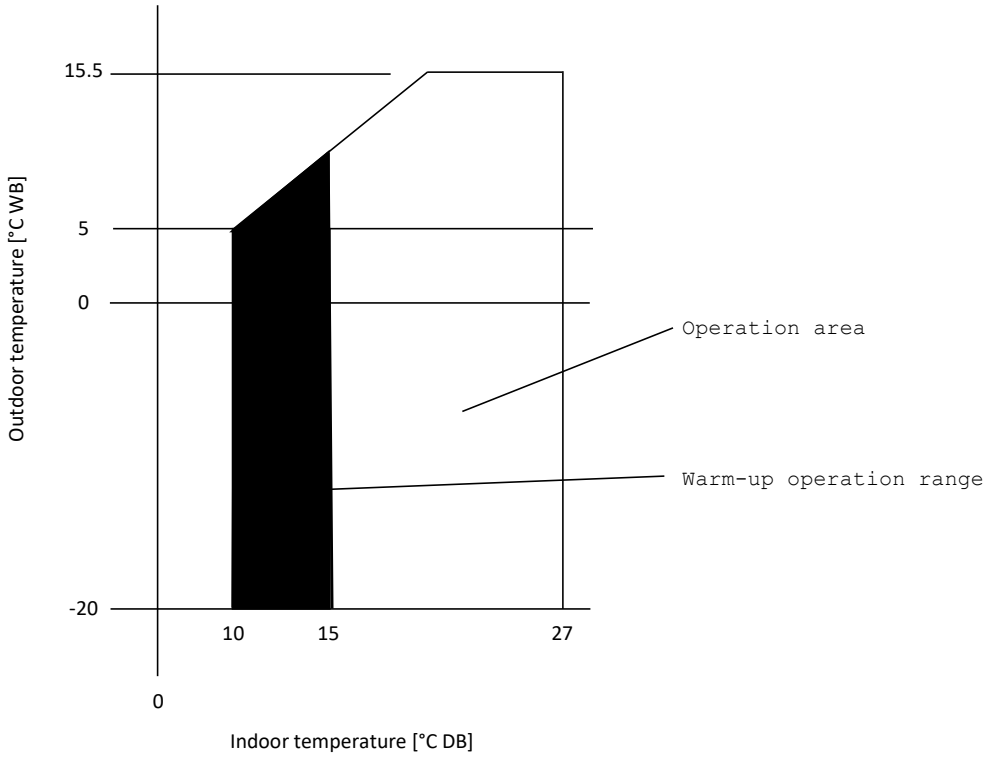