


Outdoor unit

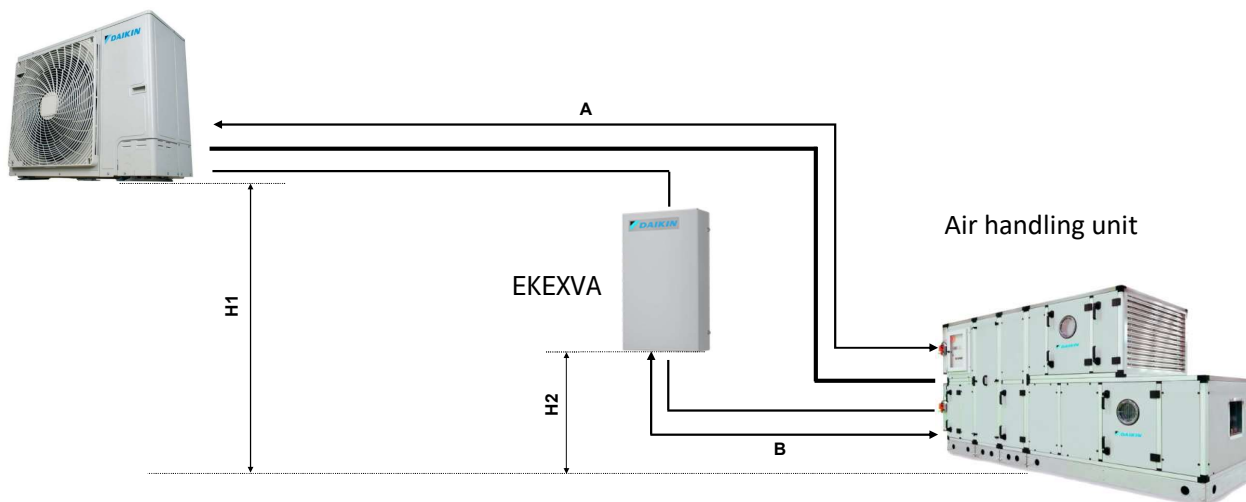

Notes

1. Schematic indication
Illustrations may differ from the actual appearance of the unit.
2. This is only to illustrate piping length limitations.
Refer to combination table ·4D153871· for details about the allowed combinations.

	Maximum allowed piping length		Maximum height difference	
	Indoor-to-outdoor (A) Actual / (Equivalent)	·EKEXVA· to ·AHU· (B)	Indoor-to-outdoor (H1) Outdoor above indoor / (indoor above outdoor)	·EKEXVA· to ·AHU· (H2)
Air handling unit (AHU) Single indoor unit pair connection (-3-)	50/(55m)	5m	40/(40)m	5m

3. For more information, refer to the installation manual of this outdoor unit.
4. Compatible air curtains are considered air handling units, following air handling unit limitations.
For information on the operation range, refer to the documentation of the compatible unit.
5. ·EKEXVA + EKEA· units combined with an air handling unit are considered air handling units, following air handling unit limitations.