


Indoor unit installation

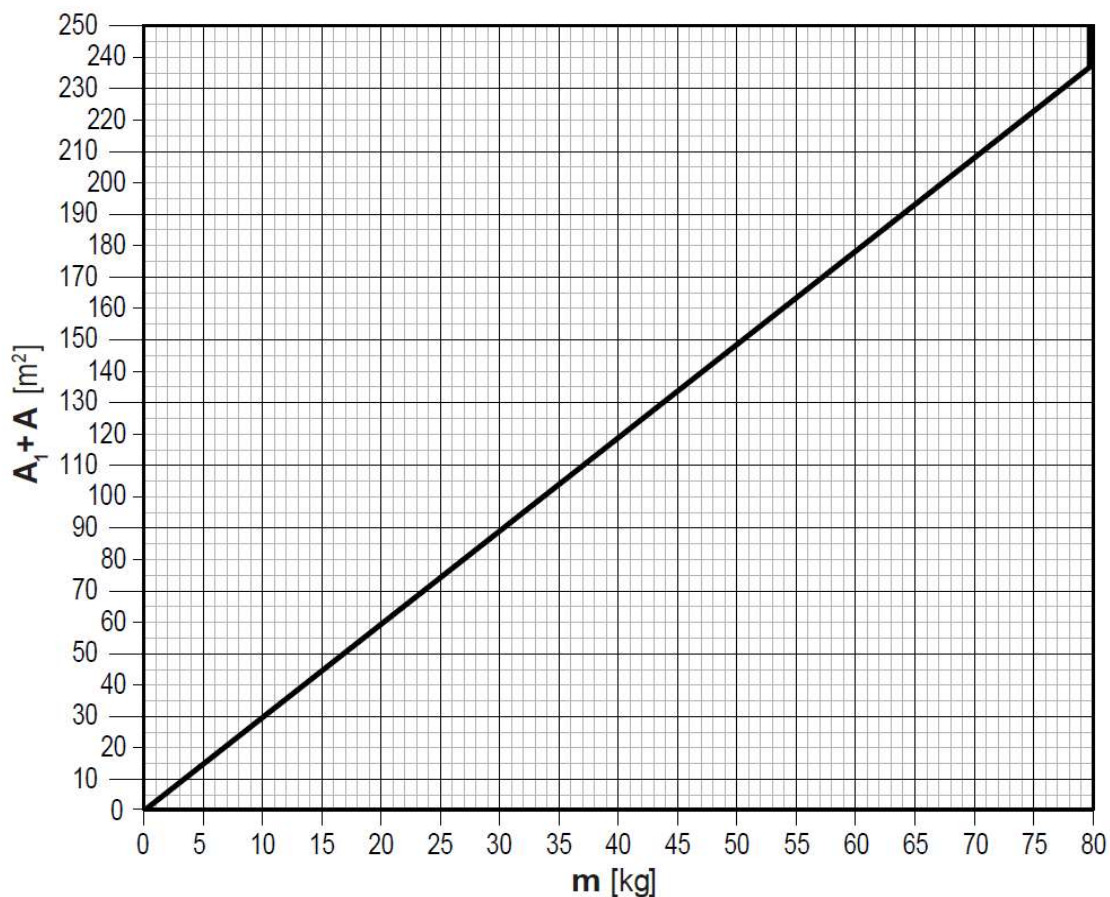

$A_1 + A [m^2]$	$m [kg]$
0	0
10	3.3
20	6.7
30	10.1
40	13.5
50	16.8
60	20.2
70	23.6
80	27.0
90	30.3
100	33.7
110	37.1
120	40.5
130	43.9
140	47.2
150	50.6
160	54.0
170	57.4
180	60.7
190	64.1
200	67.5
210	70.9
220	74.2
230	77.6
236	79.6
237	79.8
240	79.8
250	79.8

m Total refrigerant charge limit in the system [kg]

A_1 Area of the room with natural ventilation [m^2]

A Area of the room where an air curtain is installed/serving [m^2]

Step -3-

The total amount of refrigerant in the system shall be less than or equal to the maximum allowed total refrigerant amount.

If NOT, natural ventilation safety measure is not allowed.

Step -4-

The partition between two rooms on the same floor MUST meet one of the two requirements for natural ventilation.

For details, see the manual of the -outdoor- unit.