


Outdoor unit

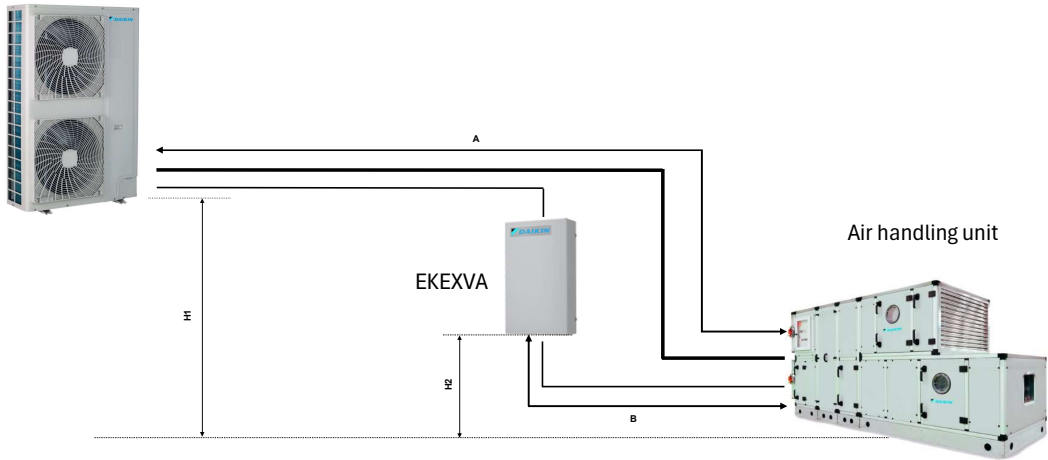

Notes

- 1. Schematic indication
Illustrations may differ from the actual appearance of the unit.
- 2. This is only to illustrate piping length limitations.
Refer to combination table -4D153871- for details about the allowed combinations.

	Maximum allowed piping length		Maximum height difference	
	Indoor-to-outdoor (A)	-EKEEXVA- to -AHU- (B)	Indoor-to-outdoor (H1)	-EKEEXVA- to -AHU- (H2)
	Actual / (Equivalent)		Outdoor above indoor / (indoor above outdoor)	
Air handling unit (AHU)	50/(55m)	5m	40/(40)m	5m
Single indoor unit pair connection (-3-)				

- 3. For more information, refer to the installation manual of this outdoor unit.
- 4. Compatible air curtains are considered air handling units, following air handling unit limitations.
For information on the operation range, refer to the documentation of the compatible unit.
- 5. -EKEEXVA + EKEA- units combined with an air handling unit are considered air handling units, following air handling unit limitations.